

# Electrical accessories — Circuit-breakers for overcurrent protection for household and similar installations —

Part 2: Circuit-breakers for a.c and d.c.  
operation

The European Standard EN 60898-2:2006 has the status of a  
British Standard

ICS 29.120.50





## National foreword

This British Standard was published by BSI. It is the UK implementation of EN 60898-2:2006. It was derived by CENELEC from IEC 60898-2:2006. It supersedes BS EN 60898-2:2001 which will be withdrawn on 1 June 2010.

The UK participation in its preparation was entrusted by Technical Committee PEL/23, Electrical accessories, to Subcommittee PEL/23/1, Circuit breakers and similar equipment for household use.

A list of organizations represented on PEL/23/1 can be obtained on request to its secretary.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

Compliance with a British Standard cannot confer immunity from legal obligations.

### Amendments issued since publication

Amd. No.	Date	Comments
16750	31 October 2006	Correction to national foreword
Corrigendum No. 1		

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 31 October 2006

© BSI 2006

ISBN 0 580 49325 3

English version

**Electrical accessories –  
Circuit-breakers for overcurrent protection  
for household and similar installations  
Part 2: Circuit-breakers for a.c. and d.c. operation  
(IEC 60898-2:2000 + A1:2003, modified)**

Petit appareillage électrique –  
Disjoncteurs pour la protection contre les  
surintensités pour installations  
domestiques et analogues  
Partie 2: Disjoncteurs pour le  
fonctionnement en courant alternatif  
et en courant continu  
(CEI 60898-2:2000 + A1:2003, modifiée)

Elektrisches Installationsmaterial –  
Leitungsschutzschalter  
für Hausinstallationen und  
ähnliche Zwecke  
Teil 2: Leitungsschutzschalter  
für Wechsel- und Gleichstrom  
(AC und DC)  
(IEC 60898-2:2000 + A1:2003, modifiziert)

This European Standard was approved by CENELEC on 2005-06-01. CENELEC members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Central Secretariat or to any CENELEC member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CENELEC member into its own language and notified to the Central Secretariat has the same status as the official versions.

CENELEC members are the national electrotechnical committees of Austria, Belgium, Cyprus, the Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, the Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and the United Kingdom.

**CENELEC**

European Committee for Electrotechnical Standardization  
Comité Européen de Normalisation Electrotechnique  
Europäisches Komitee für Elektrotechnische Normung

**Central Secretariat: rue de Stassart 35, B - 1050 Brussels**

## Foreword

The text of the International Standard IEC 60898-2:2000 + A1:2003, together with common modifications prepared by the Technical Committee CENELEC TC 23E, Circuit breakers and similar devices for household and similar applications, was submitted to the Unique Acceptance Procedure and was approved by CENELEC as EN 60898-2 on 2005-06-01.

This European Standard supersedes EN 60898-2:2001.

The following dates were fixed:

- latest date by which the EN has to be implemented at national level by publication of an identical national standard or by endorsement (dop) 2007-03-01
- latest date by which the national standards conflicting with the EN have to be withdrawn (dow) 2010-06-01

In this European Standard the common modifications to the International Standard are indicated by a vertical line in the left margin of the text.

This Part 2 is to be used in conjunction with EN 60898-1:2003 + corrigendum February 2004 + A1:2004.

When a particular subclause of Part 1 is not mentioned in this Part 2, that subclause applies as far as is reasonable. Where this Part 2 states "addition", "modification" or "replacement", the relevant text of Part 1 is to be adapted accordingly.

In this standard, the following print types are used:

- requirements: roman type;
  - *test specifications: italic type;*
  - notes: smaller roman type.
-

## 1 Scope and object

This clause of Part 1 is applicable except as follows:

*Addition at the end of the first paragraph:*

This standard gives additional requirements for single- and two-pole circuit-breakers which, in addition to the above characteristics, are suitable for operation with direct current, and have a rated d.c. voltage not exceeding 220 V for single-pole and 440 V for two-pole circuit-breakers, a rated current not exceeding 125 A and a rated d.c. short-circuit capacity not exceeding 10 000 A.

NOTE This standard applies to circuit-breakers able to make and break both a.c. current and d.c. current.

*Delete the last two paragraphs.*

## 2 Normative references

This clause of Part 1 applies.

## 3 Definitions

Clause 3 of Part 1 applies with the following modification:

*Addition:*

### 3.5.10.3

#### **time constant**

the rise time  $T = L/R$  (ms) of a prospective direct current to reach a value of 0,63 times the maximum peak current

## 4 Classification

Clause 4 of Part 1 applies with the following modifications:

### 4.1 According to the number of poles

*Replacement:*

- single-pole circuit-breakers;
- two-pole circuit-breakers with two protected poles.

### 4.5 According to the instantaneous tripping current (see 3.5.17)

*Delete D-Type.*

*Addition:*

### 4.7 According to the time constant

- Circuit-breakers suitable for d.c. circuits with a time constant of  $T \leq 4$  ms.
- Circuit-breakers suitable for d.c. circuits with a time constant of  $T \leq 15$  ms.

NOTE It is assumed that short-circuit currents of 1 500 A are not exceeded in installations in which, due to the loads connected, time constants in normal service up to 15 ms can occur. Where higher short-circuit currents may occur, the time constant of  $T = 4$  ms is considered sufficient.

**5 Characteristics of circuit-breakers**

Clause 5 of Part 1 applies with the following modification:

**5.3.1 Standard values of rated voltage**

*Replacement:*

The standard values of rated voltages are given in Table 1.

Examples of connections of circuit-breakers in d.c. systems are given in Figure 18.

**Table 1 – Standard values of rated voltage**

Circuit-breakers	AC		DC <sup>a</sup>	
	AC circuit supplying the circuit-breaker	Rated voltage a.c.	Rated voltage d.c.	DC wiring examples
Single-pole	Single phase (phase to neutral or phase to phase)	230 V	220 V	Figure 18a
	Single phase (phase to neutral) or three-phase, using 3 single-pole circuit-breakers (3-wire or 4-wire)	(230/400) V	220 V	
Two-pole	Single phase (phase to phase)	400 V	(220/440) V	Figures 18b, 18c, 18d

Applicable for d.c. voltages:  
a The rated voltage per pole shall not exceed 220 V d.c.

Applicable for a.c. voltages:

NOTE 1 In IEC 60038 the network voltage value of (230/400) V has been standardized. This value should progressively supersede the values of (220/380) V and (240/415) V.

NOTE 2 Wherever in this standard there is a reference to 230 V or 400 V, it may be read as 220 V or 240 V, and 380 V or 415 V respectively.

NOTE 3 Circuit-breakers complying with the requirements of this standard may be used in IT systems.

Two-pole circuit breakers rated 230 V may have one or two protected poles.

Two-pole circuit breakers rated 400 V shall have two protected poles.

Three-pole circuit breakers shall have three protected poles.

Four-pole circuit breakers may have three or four protected poles.

The manufacturer shall declare in his literature the minimum voltage for which the circuit-breaker is designed.

*Relevant tests are under consideration.*

5.3.5 Standard ranges of instantaneous tripping

Replacement of Table 2:

**Table 2 – Ranges of instantaneous tripping**

Type	Ranges for a.c.	Ranges for d.c.
<b>B</b>	Above $3 I_n$ up to and including $5 I_n$	Above $4 I_n$ up to and including $7 I_n$
<b>C</b>	Above $5 I_n$ up to and including $10 I_n$	Above $7 I_n$ up to and including $15 I_n$

6 Marking and other product information

Clause 6 of Part 1 applies with the following modifications:

6.1 Standard marking

Replacement:

- c) rated a.c. voltage with the symbol  $\sim$  and rated d.c. voltage with the symbol  $\overline{\overline{\quad}}$  ;
- d) rated current without symbol "A", preceded by the symbol of instantaneous tripping (B or C), for example B 16;
- f) rated short-circuit capacity for a.c. and d.c. in amperes in one rectangle, without the symbol A, if valid for both a.c. and d.c. (see example 1 below). If the rated short-circuit capacity is different for a.c. and d.c. this shall be indicated in two adjacent rectangles, without the symbol A, with the symbol  $\sim$  near the rectangle containing the a.c. value and with the symbol  $\overline{\overline{\quad}}$  near the rectangle containing the d.c. value (see example 2 below);

Addition:


- l) time constant T15 within a rectangle, if applicable, associated with the marking for the short-circuit capacity at the time constant of 15 ms (see example 3 below).

Replacement of the first paragraph after l):

If, for small devices, the space available does not allow all the above data to be marked, at least the information under c) and d) shall be marked and visible when the circuit-breaker is installed.

The information under a), b), c), f), g) and j) may be marked on the side or on the back of the device and be visible only before the device is installed.

Alternatively, the information under g) may be on the inside of any cover which has to be removed in order to connect the supply wires. Any remaining information not marked shall be given in the manufacturer's literature.

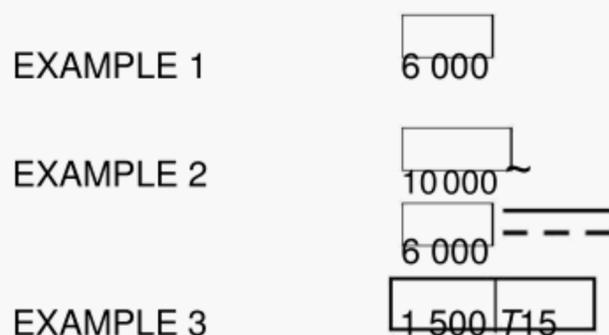

The terminals shall be marked with + or - if necessary. Additionally, arrows indicating the direction of the current are allowed.

6.3 Guidance table for marking

Replacement:

	Markings may be on the circuit-breaker itself	Product information in catalogue			
			If, for small devices the space available does not allow all the above data to be marked, at least this information shall be marked and <b>visible</b> when the device is installed.	This information may be marked on the <b>side</b> or on the back of the device and be visible only before the device is installed.	Alternatively the information may be on the inside of any <b>cover</b> which has to be removed in order to connect the supply wires.
a) manufacturer's name or trademark			X		
b) type designation, catalogue number or serial number			X		
c) rated a.c. voltage with the symbol $\overline{\text{---}}$ and rated d.c. voltage with the symbol $\overline{\text{---}}$ .	X				
d) rated current without symbol "A" preceded by the symbol of overcurrent instantaneous tripping (B or C), for example B 16	X				
e) rated frequency if the circuit-breaker is designed only for one frequency (see 5.3.3)					X
f) rated short-circuit capacity for a.c. and d.c. in amperes in one rectangle, without the symbol A, if valid for both a.c. and d.c. (see example 1 in 6.1). If the rated short-circuit capacity is different for a.c. and d.c. this shall be indicated in two adjacent rectangles, without the symbol A, with the symbol $\square$ near the rectangle containing the a.c. value and with the symbol $\overline{\text{---}}$ near the rectangle containing the d.c. value (see example 2 in 6.1)			X <sup>a</sup>		
g) wiring diagram, unless the correct mode of connection is evident			X	X	
h) reference calibration temperature, if different from 30 °C					X
i) the degree of protection (only if different from IP20)					X
j) energy limiting class (e.g. 3) in a square in accordance with Annex ZA, if applied			X <sup>a</sup>		
k) breaking capacity on one pole of multipole circuit-breakers in case of short-circuit to earth $I_{cn1}$					X
l) time constant T15 within a rectangle, if applicable, associated with the marking for the short-circuit capacity at the time constant of 15 ms (see example 3 in 6.1)					
the position of use (symbol according to EN 60051), if necessary			X		
indication of the terminal for the neutral with "N"			X		
additional marking of performance to other standards			X		

<sup>a</sup>  $I_{cn}$  and the energy limiting class, if applied, shall be both on the device and combined together.

## 7 Standard conditions for operation in service

Clause 7 of Part 1 applies.

## 8 Requirements for construction and operation

Clause 8 of Part 1 applies with the following modifications:

### 8.1.3 Clearances and creepage distances (see annex B)

Addition of the following note 4 to Table 4:

NOTE 4 The values given for 230 V, 230/400V and 400 V a.c., are also valid for 220 V and 440 V d.c.

### 8.6.1 Standard time-current zone

Replacement:

**Table 7 – Time-current operating characteristics**

Test	Type	Test current a.c.	Test current d.c.	Initial condition	Limits of tripping or non-tripping time	Result to be obtained	Remarks
a	B, C	1,13 $I_n$		Cold*	$t \geq 1 \text{ h}$ ( $I_n \leq 63 \text{ A}$ ) $t \geq 2 \text{ h}$ ( $I_n > 63 \text{ A}$ )	No tripping	
b	B, C	1,45 $I_n$		Immediately following test a	$t < 1 \text{ h}$ ( $I_n \leq 63 \text{ A}$ ) $t < 2 \text{ h}$ ( $I_n > 63 \text{ A}$ )	Tripping	Current steadily increased within 5 s
c	B, C	2,55 $I_n$		Cold*	$1 \text{ s} < t < 60 \text{ s}$ ( $I_n \leq 32 \text{ A}$ ) $1 \text{ s} < t < 120 \text{ s}$ ( $I_n > 32 \text{ A}$ )	Tripping	
d	B C	3 $I_n$ 5 $I_n$	4 $I_n$ 7 $I_n$	Cold*	0,1 < $t$ < 45 s ( $I_n \leq 32 \text{ A}$ ) 0,1 < $t$ < 90 s ( $I_n > 32 \text{ A}$ ) 0,1 < $t$ < 15 s ( $I_n \leq 32 \text{ A}$ ) 0,1 < $t$ < 30 s ( $I_n > 32 \text{ A}$ )	Tripping	Current established by closing an auxiliary switch
e	B C	5 $I_n$ 10 $I_n$	7 $I_n$ 15 $I_n$	Cold*	$t < 0,1 \text{ s}$	Tripping	Current established by closing an auxiliary switch

\* The term "cold" means without previous loading, at the reference calibration temperature.

### 8.8 Performance at short-circuit currents

Replacement of the third paragraph:

It is required that circuit-breakers be able to make and to break any value of current up to and including the value corresponding to the rated short-circuit capacity at rated frequency, at a power-frequency recovery voltage equal to 105 % ( $\pm 5$  %) of the rated operational voltage and at any power factor not less or any time constant not greater than the appropriate limit of the range stated in 9.12.5; it is also required that the corresponding values of  $I^2 t$  lie below the  $I^2 t$  characteristic (see 3.5.13).

## 9 Tests

Clause 9 of Part 1 applies with the following modifications:

### 9.1 Type tests and test sequences

*Replacement of the second paragraph after "Table 8 (void)":*

*The test sequences and the number of samples to be submitted are stated in Annex C of this standard.*

#### 9.10.2 Test of instantaneous tripping and of correct opening of the contacts

*Replacement:*

##### 9.10.2.2 For circuit-breakers of the B-type

*An alternating current equal to  $3 I_n$  is passed through all poles, starting from cold. The opening time shall be not less than 0,1 s and not more than:*

- 45 s for rated currents up to and including 32 A;*
- 90 s for rated currents above 32 A.*

*An alternating current equal to  $5 I_n$  is then passed through all poles, starting from cold.*

*The circuit-breaker shall trip in a time less than 0,1 s.*

*A direct current equal to  $4 I_n$  is passed through all poles, starting from cold.*

*The opening time shall be not less than 0,1 s and not more than:*

- 45 s for rated currents up to and including 32 A;*
- 90 s for rated currents above 32 A.*

*A direct current equal to  $7 I_n$  is then passed through all poles, starting from cold.*

*The circuit-breaker shall trip in a time less than 0,1 s.*

*Moreover the circuit-breaker shall perform the test of 9.10.1.2.*

##### 9.10.2.3 For circuit-breakers of the C-type

*An alternating current equal to  $5 I_n$  is passed through all poles, starting from cold.*

*The opening time shall be not less than 0,1 s and not more than:*

- 15 s for rated currents up to and including 32 A;*
- 30 s for rated currents above 32 A.*

*An alternating current equal to  $10 I_n$  is then passed through all poles, starting from cold.*

*The circuit-breaker shall trip in a time less than 0,1 s.*

*Moreover the circuit-breaker shall perform the test of 9.10.1.2.*

*A direct current equal to  $7 I_n$  is passed through all poles, starting from cold.*

*The opening time shall be not less than 0,1 s and not more than:*

- 15 s for rated currents up to and including 32 A;
- 30 s for rated currents above 32 A.

A direct current equal to 15  $I_n$  is then passed through all poles, starting from cold.

The circuit-breaker shall trip in a time less than 0,1 s.

**9.11 Test of mechanical and electrical endurance**

**9.11.1 General test conditions**

Replacement of the fourth paragraph:

The alternating current shall have a substantially sine-wave form and the power factor shall be between 0,85 and 0,9.

The direct current shall have a ripple of  $\omega \leq 5\%$  and a time constant of  $T = 4\text{ ms}$  (with a tolerance of 0

-  $\frac{0}{10}\%$ ) or, for circuit-breakers marked with T15, a time constant of  $T = 15\text{ ms}$

(with a tolerance of 0

-  $\frac{0}{10}\%$ ).

**9.11.2 Test procedure**

Replacement of the first paragraph:

One set of circuit-breakers is submitted to 4 000 operating cycles at alternating current, and another set to 1 000 operating cycles at direct current, both at their rated current.

**9.12.3 Tolerances and test quantities**

Addition:

- ripple  $\leq 5\%$

- time constant 0  
-  $\frac{0}{10}\%$ .

**9.12.5 Power factor of the test circuits**

Replacement:

**9.12.5 Power factor and time constant of the test circuits**

Addition:

For d.c. test currents up to and including 1 500 A, one of the following time constants shall be used:

$T = L / R = 4\text{ ms}$  for devices not marked T15

$T = L / R = 15\text{ ms}$  for devices marked T15.

For d.c. tests currents above 1 500 A and less than or equal to 10 000 A, the tests for all samples are made at the time constant of  $T = 4\text{ ms}$ .

NOTE It is assumed that short-circuit currents of 1 500 A are not exceeded in installations in which, due to the loads connected, time constants in normal service up to 15 ms can occur. Where higher short-circuit currents may occur, the time constant of  $T = 4\text{ ms}$  is considered sufficient.

### 9.12.8 Interpretation of records

*Replacement of the title of 9.12.8.1 by:*

#### 9.12.8.1 Interpretation of records in case of a.c. voltage

*Addition:*

#### 9.12.8.3 Interpretation of records in case of d.c. voltage

a) *Determination of the applied voltage and the recovery voltage.*

*The applied voltage and the recovery voltage are determined from the record taken during the break test.*

*The voltage on the supply side shall be measured after arc extinction and after high frequency phenomena have subsided.*

b) *Determination of the prospective short-circuit current.*

NOTE NOTE The value of the prospective current is taken as being equal to the maximum value  $A_2$  as determined from the calibration curve because circuit-breakers according to this standard break the current before it has reached its maximum value.

*The maximum value of the prospective current is indicated as  $A_2$  in Figure 7b.*

### 9.12.11 Test procedure

*Replacement of the title of 9.12.11.2 by:*

#### 9.12.11.2 Tests at reduced short-circuit currents and at small direct currents

*Replacement of the title of 9.12.11.2.1 by:*

##### 9.12.11.2.1 Tests at reduced a.c. short-circuit currents

*Addition:*

##### 9.12.11.2.3 Tests at reduced d.c. short-circuit currents

*At direct currents the test circuit is adjusted so as to obtain a current of 500 A or  $10 \times I_n$  whichever is the higher, at a time constant corresponding to the assigned time constant.*

*Each of the protected poles of the circuit-breaker is subjected separately to a test in a circuit, of which the connections are shown in Figure 3.*

*The circuit-breaker is caused to open automatically three times, the circuit being closed once by the auxiliary switch A and twice by the circuit-breaker itself.*

*The sequence of operations shall be:*

$O - t - CO - t - CO$

*After arc extinction, the recovery voltage shall be maintained for a duration not less than 0,1 s.*

#### **9.12.11.2.4 Test at small direct currents up to and including 150 A**

*The circuit-breaker shall be closed three times on to each of the test currents listed below; during the tests the operating means is actuated as in normal use. If the circuit-breaker does not trip, it shall be switched off manually.*

*Test currents: 1 A, 2 A, 4 A, 8 A, 16 A, 32 A, 63 A, 150 A*

*The time between each operating cycle CO shall be at least 10 s, the closing time shall not be longer than 2 s. The time between the various test currents shall be at least 2 min.*

*The time of the arc extinction during the test shall not exceed 1 s.*

#### **9.12.11.3 Test at 1 500 A**

*Replacement of the first paragraph:*

*For circuit-breakers having rated short-circuit capacity of 1 500 A, the test circuit is calibrated according to 9.12.7.1 and 9.12.7.2, to obtain a current of 1 500 A at a power factor corresponding to this current according to Table 17.*

*For direct current the time constant is calibrated corresponding to the assigned time constant.*

*Replacement of the second paragraph:*

*For circuit-breakers having rated short-circuit capacity exceeding 1 500 A, the test circuit is calibrated according to 9.12.7.1 and 9.12.7.3, at a power factor corresponding to 1 500 A, according to Table 17.*

*For direct current the time constant is calibrated corresponding to the assigned time constant.*

*Replace the eleventh paragraph:*

*The sequence of operations shall be as specified in 9.12.11.2.1 and 9.12.11.2.3.*

*For single-pole circuit-breakers of rated voltage 230/400 V the operations for a.c. are as follows:*

*Subsequent to the six O operations only two CO operations are performed. In addition, these circuit-breakers are then tested by performing simultaneously one O operation, with one circuit-breaker being inserted in each phase of the test circuit for three-pole circuit-breakers (see Figure 5). For this test the auxiliary switch establishing the short-circuit is not synchronized.*

*For the tests at d.c.*

- single-pole circuit-breakers of rated voltage 220 V are tested in a circuit according to Figure 3;*
- two-pole circuit-breakers of rated voltage 440 V are tested in a circuit according to Figure 4b.*

**9.12.11.4.2 Test at service short-circuit capacity ( $I_{cs}$ )**

*Replacement of the first paragraph of a):*

- a) *The test circuit is calibrated according to 9.12.7.1 and 9.12.7.3, on a.c. with a power factor according to Table 17, or on d.c. with a time constant according to 9.12.5.*

*Addition:*

- e) *In the case of direct current, the test sequence for single- and two-pole circuit-breakers is:*

*O – t – CO – t – CO*

*Three operations are made, the circuit being closed once by the auxiliary switch A and twice by the circuit-breaker.*

*Single-pole circuit-breakers of rated voltage 220 V are tested in a circuit according to Figure 3.*

*Two-pole circuit-breakers of rated voltage 440 V are tested in a circuit according to Figure 4b.*

**9.12.11.4.3 Test at rated short-circuit capacity ( $I_{cn}$ )**

*Replacement of the first paragraph:*

- a) *The test circuit is calibrated according to 9.12.7.1 and 9.12.7.2, on a.c. with a power factor according to Table 17, on d.c. with a time constant according to 9.12.5.*

*Addition:*

- c) *In the case of direct current, the test sequence for single- and two-pole circuit-breakers is:*

*O – t – CO*

*Two operations are made, the circuit being closed once by the auxiliary switch A and once by the circuit-breaker.*

*Single-pole circuit-breakers of rated voltage 220 V are tested in a circuit according to Figure 3.*

*Two-pole circuit-breakers of rated voltage 440 V are tested in a circuit according to Figure 4b.*

**9.12.12 Verification of the circuit-breaker after short-circuit tests**

*Addition at the end of 9.12.12.2:*

*The test of 9.12.11.2.4 is repeated but the test currents 63 A and 150 A are omitted.*


**Figures**

The figures of Part 1 apply with the following modifications:

*Renumber Figure 7 as Figure 7a and replace the title by:*

**Figure 7a – Calibration of the test circuit**

*Addition:*

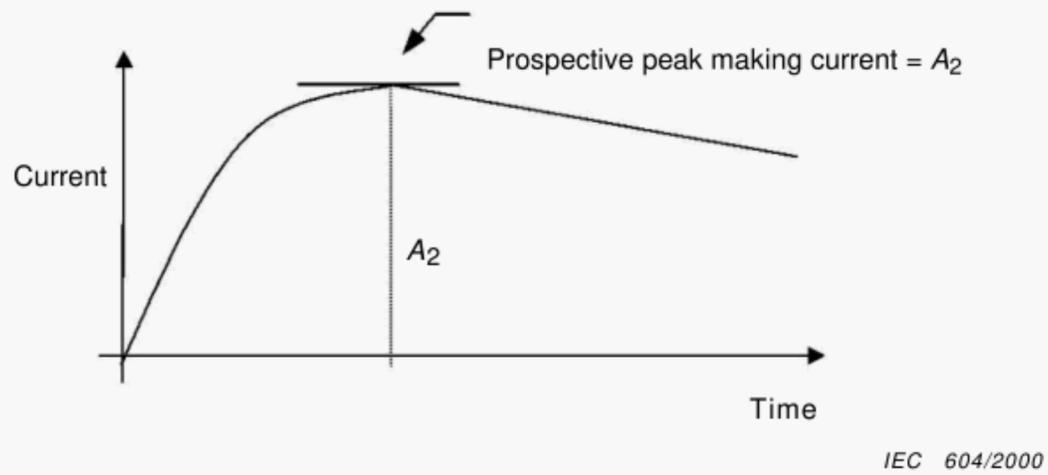

**Figure 7b – Calibration of the test circuit in case of direct currents**

Addition:

	a	b	c	d
Circuit-breaker rated voltage	220 V	220/440 V	220/440 V	220/440 V
Maximum voltage between the conductors	220 V	440 V	440 V	440 V
Maximum voltage between conductor and earth	220 V	220 V	440 V <sup>a</sup>	220 V
Circuit breaker	Single-pole	Two-pole	Two-pole	Two-pole
Circuit				
<sup>a</sup> For applications with an earthed negative pole, where the voltage to earth is higher than the rated voltage of a single-pole circuit-breaker.				

IEC 773/03

Figure 18 – Examples of connections of the circuit-breakers in different d.c. systems

## **Annexes**

The annexes of Part 1 are applicable, except as follows:

## Annex C

Annex C of Part 1 applies with the following modifications:

Replacement:

**Table C.1 – Test sequences and number of samples necessary to prove compliance with the standard**

Test sequence		Clause or subclause	Test (or inspection)		
A		6		Marking	
		8.1.1		General	
		8.1.2		Mechanism	
		9.3		Indelibility of marking	
		8.1.3		Clearances and creepage distances (external parts only)	
		8.1.6		Non-interchangeability	
		9.4		Reliability of screws, current-carrying parts and connections	
		9.5		Reliability of screw-type terminals for external copper conductors	
		9.6		Protection against electric shock	
		8.1.3		Clearances and creepage distances (internal parts only)	
B		9.14		Resistance to heat	
		9.15		Resistance to abnormal heat and to fire	
		9.16		Resistance to rusting	
C	C <sub>1</sub>	9.7		Dielectric properties and isolating capability	
		9.8		Temperature rise and power loss	
		9.9		28-day test	
	C <sub>1</sub>	9.11	a.c.		Mechanical and electrical endurance
					9.12.11.2.1
		9.12.12			Verification of circuit-breaker after short-circuit tests
					9.11
	9.12.11.2.3	d.c.		Test at reduced d.c. short-circuit currents	
				9.12.11.2.4	Test at small direct currents up to and including 150 A
	C <sub>2</sub>	9.12.12			Verification of circuit-breaker after short-circuit tests
9.12.11.2.2					Short-circuit test for verifying the suitability of circuit-breakers for use in IT systems
D	D <sub>0</sub>	9.12.12		Verification of circuit-breaker after short-circuit tests	
				9.10	Tripping characteristic
	D <sub>1</sub>	9.13	a.c.	d.c.	Mechanical stresses
					9.12.11.3
E	E <sub>1</sub>	9.12.12	a.c.	d.c.	Service short-circuit capacity ( $I_{cs}$ )
					9.12.11.4.2
	E <sub>2</sub>	9.12.11.4.3	a.c.	d.c.	Performance at rated short-circuit capacity ( $I_{cn}$ )
9.12.12					Verification of circuit-breaker after short-circuit tests
E <sub>3</sub>	9.12.11.4.4	a.c.		Performance at rated making and breaking capacity ( $I_{cn1}$ ) on an individual pole of multipole circuit-breakers	
		9.12.12			

NOTE With the agreement of the manufacturer the same samples may be used for more than one sequence.

Replacement:

**Table C.2 – Number of samples for full test procedure**

Test sequence	Number of samples		Minimum number of samples which shall pass the tests a, b		Number of samples for repeated tests c	
	AC	DC	AC	DC	AC	DC
	~		~		~	
A	1		1			
B	3		2		3	
C	C <sub>1</sub>	3	3	2 e	2 e	3
	C <sub>2</sub>	3	3	2 e	2 e	3
D	3	3	2 e	2 e	3	3
E <sub>1</sub>	3 + 3 d	3	2 e + 2 d, e	2 e	3 + 3 d	3
E <sub>2</sub>	3 + 4 d	3	2 e + 3 d, e	2 e	3 + 4 d	3
E <sub>3</sub>	3		2 e		3	

a In total, a maximum of two test sequences may be repeated.

b It is assumed that a sample which has not passed a test has not met the requirements due to workmanship or assembly defects which are not representative of the design.

c In the case of repeated tests, all results shall be acceptable.

d Supplementary samples in the case of single-pole circuit-breakers of rated voltage 230/400 V.

e All samples shall meet the test requirements of 9.12.10, 9.12.11.2, 9.12.11.3 and 9.12.11.4 as appropriate.

---

## BSI — British Standards Institution

BSI is the independent national body responsible for preparing British Standards. It presents the UK view on standards in Europe and at the international level. It is incorporated by Royal Charter.

### Revisions

British Standards are updated by amendment or revision. Users of British Standards should make sure that they possess the latest amendments or editions.

It is the constant aim of BSI to improve the quality of our products and services. We would be grateful if anyone finding an inaccuracy or ambiguity while using this British Standard would inform the Secretary of the technical committee responsible, the identity of which can be found on the inside front cover. Tel: +44 (0)20 8996 9000. Fax: +44 (0)20 8996 7400.

BSI offers members an individual updating service called PLUS which ensures that subscribers automatically receive the latest editions of standards.

### Buying standards

Orders for all BSI, international and foreign standards publications should be addressed to Customer Services. Tel: +44 (0)20 8996 9001. Fax: +44 (0)20 8996 7001. Email: [orders@bsi-global.com](mailto:orders@bsi-global.com). Standards are also available from the BSI website at <http://www.bsi-global.com>.

In response to orders for international standards, it is BSI policy to supply the BSI implementation of those that have been published as British Standards, unless otherwise requested.

### Information on standards

BSI provides a wide range of information on national, European and international standards through its Library and its Technical Help to Exporters Service. Various BSI electronic information services are also available which give details on all its products and services. Contact the Information Centre. Tel: +44 (0)20 8996 7111. Fax: +44 (0)20 8996 7048. Email: [info@bsi-global.com](mailto:info@bsi-global.com).

Subscribing members of BSI are kept up to date with standards developments and receive substantial discounts on the purchase price of standards. For details of these and other benefits contact Membership Administration. Tel: +44 (0)20 8996 7002. Fax: +44 (0)20 8996 7001. Email: [membership@bsi-global.com](mailto:membership@bsi-global.com).

Information regarding online access to British Standards via British Standards Online can be found at <http://www.bsi-global.com/bsonline>.

Further information about BSI is available on the BSI website at <http://www.bsi-global.com>.

### Copyright

Copyright subsists in all BSI publications. BSI also holds the copyright, in the UK, of the publications of the international standardization bodies. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI.

This does not preclude the free use, in the course of implementing the standard, of necessary details such as symbols, and size, type or grade designations. If these details are to be used for any other purpose than implementation then the prior written permission of BSI must be obtained.

Details and advice can be obtained from the Copyright & Licensing Manager. Tel: +44 (0)20 8996 7070. Fax: +44 (0)20 8996 7553. Email: [copyright@bsi-global.com](mailto:copyright@bsi-global.com).